
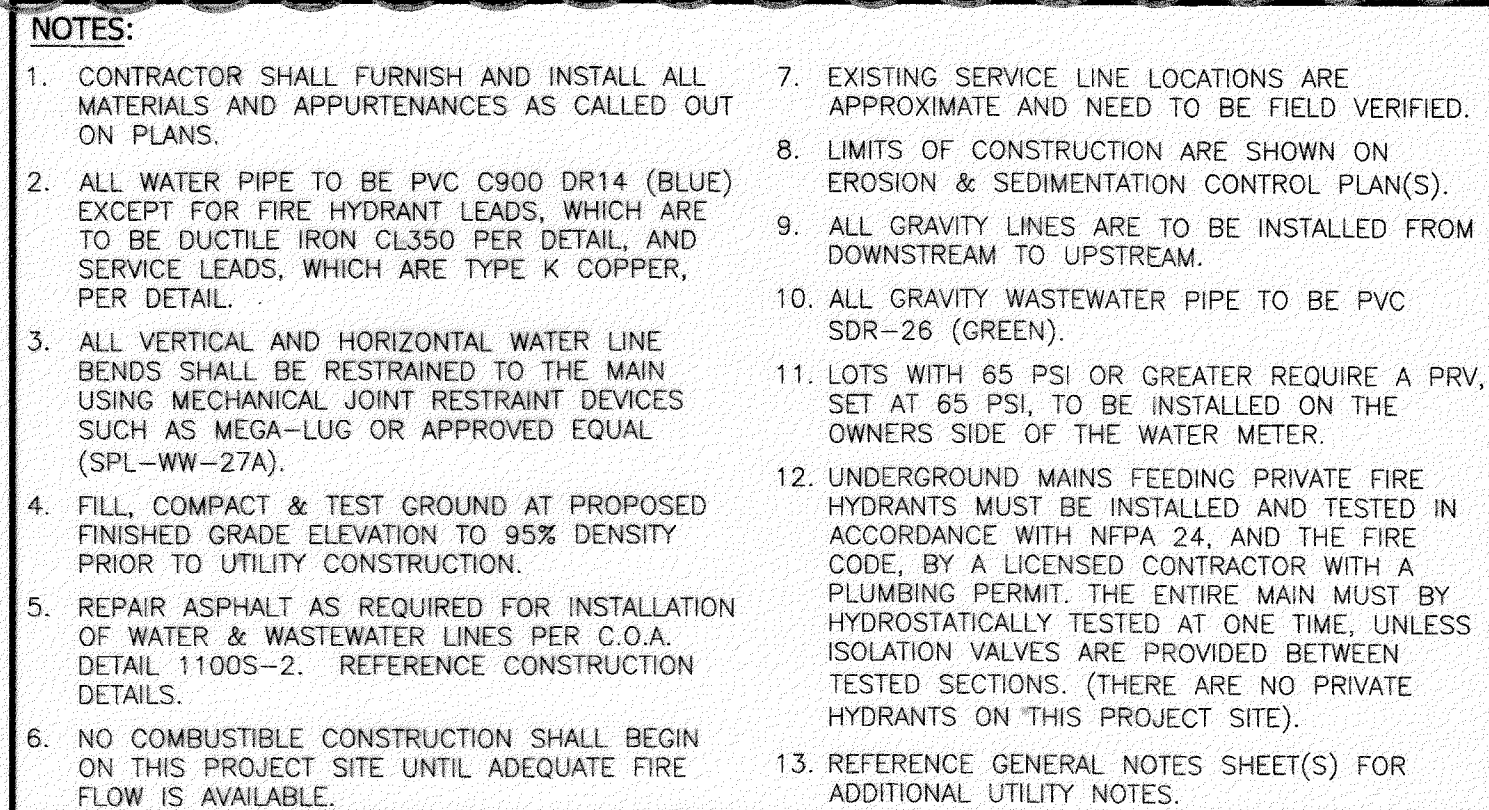
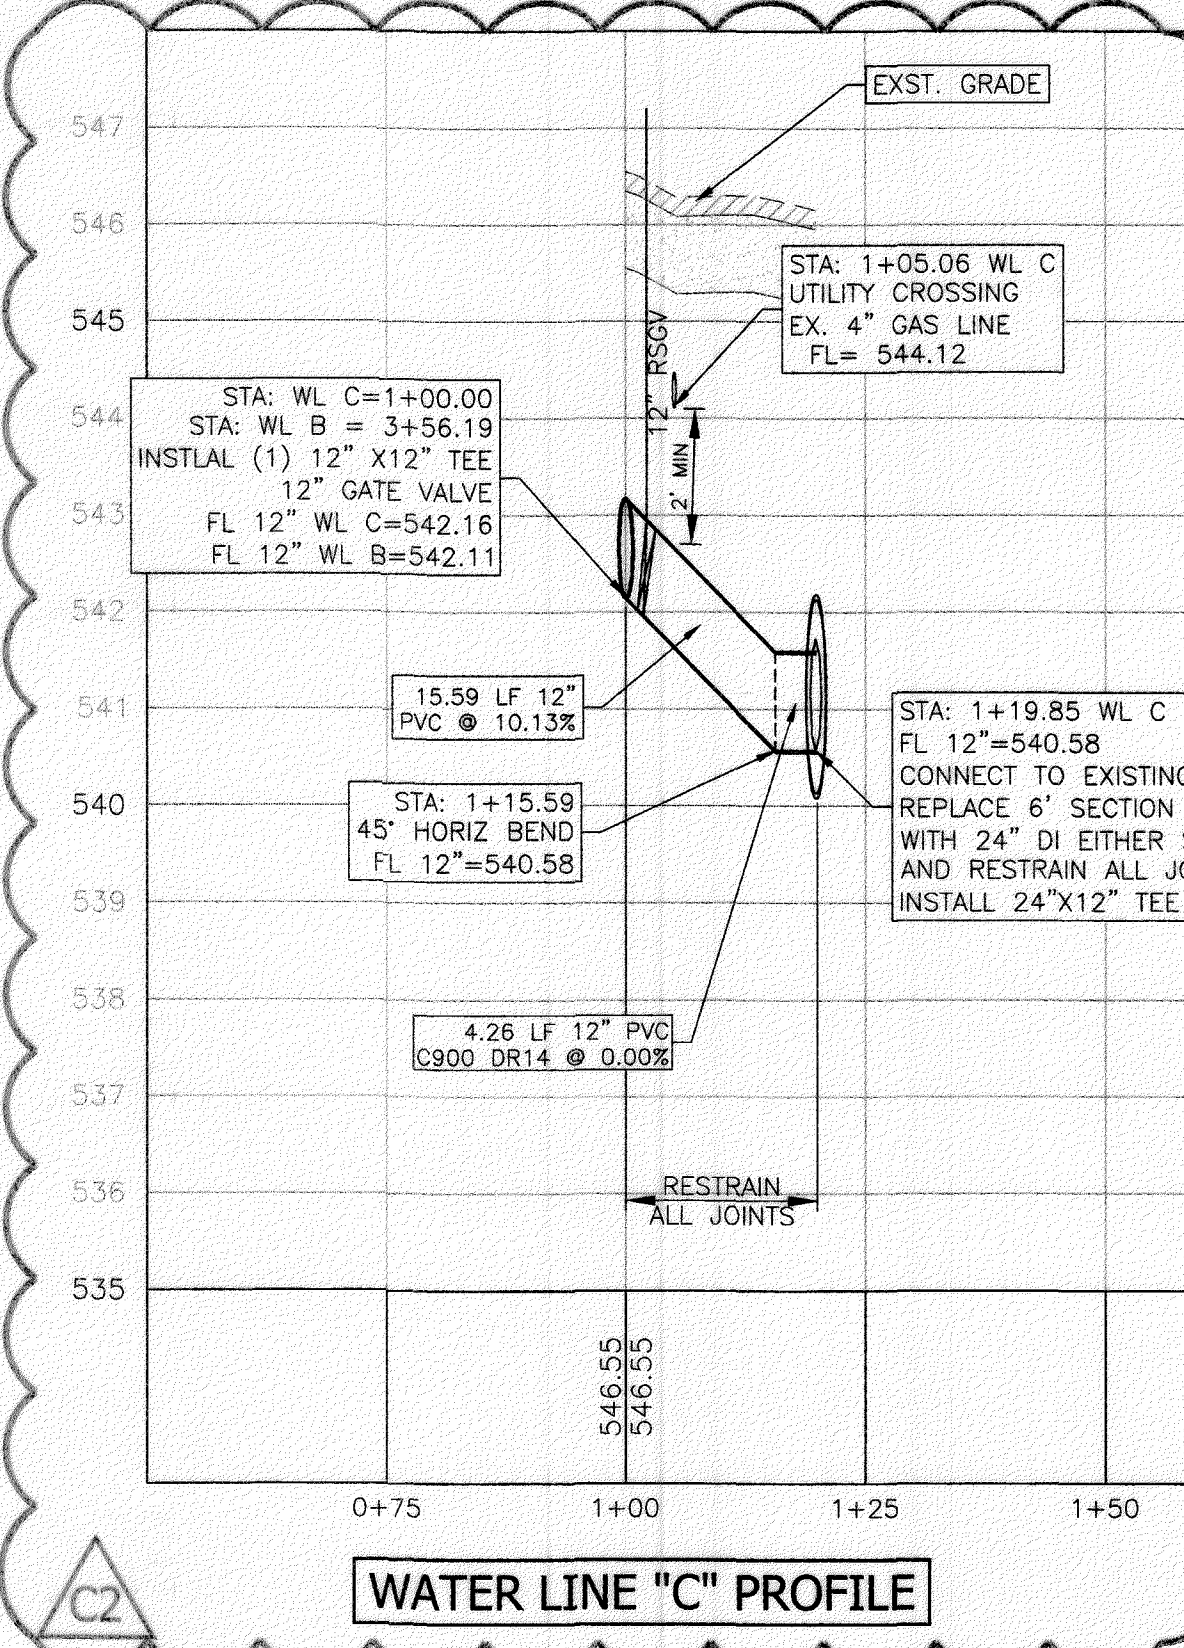


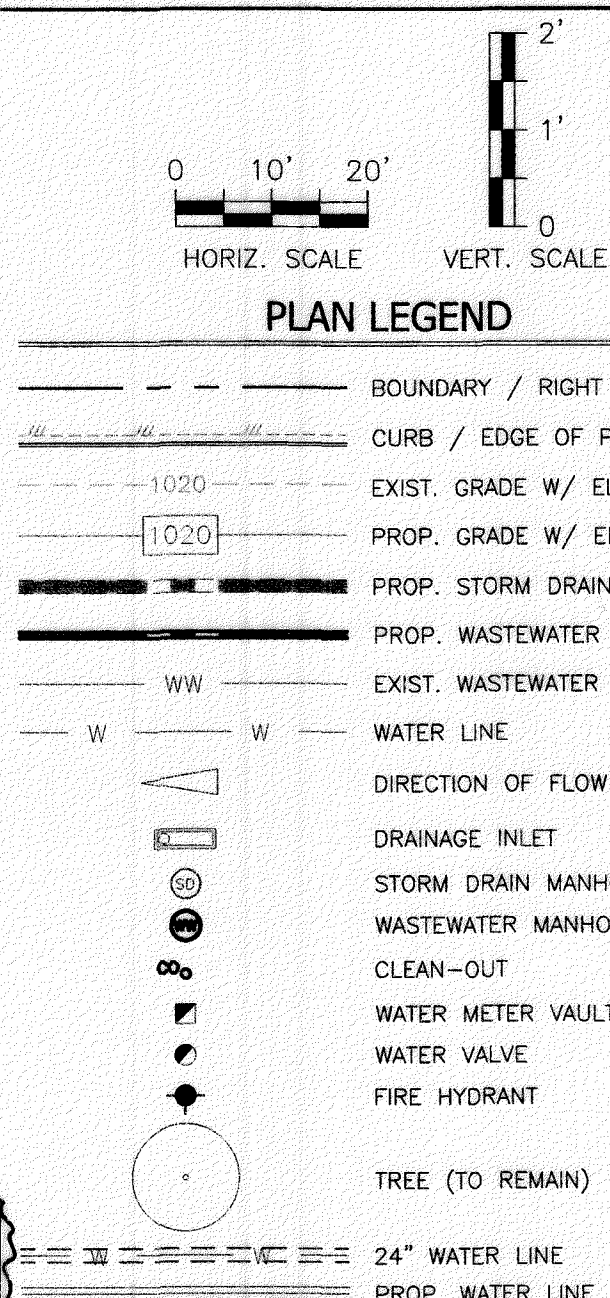

CONSTRUCTION AND SEQUENCING:

1. CONTRACTOR TO VERIFY CONSTRUCTION MEANS AND METHODS WITH DESIGN ENGINEER AND ENGINEER OF RECORD PRIOR TO CONSTRUCTION OF WATER LINE. AN ON-SITE MEETING WITH AUSTIN WATER INSPECTOR MUST BE HELD PRIOR TO CONSTRUCTION.
2. 6" GATE VALVE TO BE INSTALLED ~50 LF SOUTH OF TERMINATION OF PROPOSED WATERLINE UPGRADE TO ALLOW FOR SHUT-OFF OF EXISTING 6" AND TIE IN OF PROPOSED 12" UPSIZE.
3. CONTRACTOR TO CONSTRUCT THE REMAINDER OF THE WATERLINE IMPROVEMENTS UTILIZING THE INITIAL CONNECTION POINT. UTILITY INFRASTRUCTURE TO BE INSPECTED & TESTED PRIOR TO MAKING (2) ADDITIONAL CONNECTIONS AT THE NORTH END OF THE PROPOSED WATERLINE CONSTRUCTION.
4. CONTRACTOR TO COORDINATE SHUT-OFFS WITH CITY INSPECTOR AND AUSTIN FIRE DEPARTMENT TO AVOID ANY SHUT-OFFS OF PROPOSED WORK WHICH COULD AFFECT EXISTING UTILITIES.

REVIEWED

AUG 27 2018



Austin Water Utility

Rod Chao
ADD ~~EXCISEMENT~~ DATE/DETAILS

WARNING!

THE ENGINEER ASSUMES NO RESPONSIBILITY FOR THE ACCURACY OF THE LOCATION OF UNDERGROUND UTILITIES. THE CONTRACTOR SHALL BE RESPONSIBLE FOR AVOIDING ALL EXISTING UTILITIES BY CALLING TEXAS ONE CALL SYSTEM @ 811 FOR LOCATION OF ALL UTILITIES. AT LEAST 72 HOURS PRIOR TO BEGINNING CONSTRUCTION.

CAUTION:

CONTRACTOR TO VERIFY ALL EXISTING UTILITIES VERTICALLY AND HORIZONTALLY PRIOR TO CONSTRUCTION. CONTRACTOR TO NOTIFY THE ENGINEER IMMEDIATELY OF ANY DISCREPANCIES.

AUSTIN FIRE DEPARTMENT
As only
 NOV 02 2018
C. Mendez
 APPROVED
811
 Know what's below.
 Call before you dig.

SITE PLAN APPROVAL Sheet 14 of 38

FILE NUMBER SP-2016-0196C APPLICATION DATE APRIL 22, 2016

APPROVED BY COMMISSION ON UNDER SECTION 112 OF

CHAPTER 25-5 OF THE CITY OF AUSTIN CODE.

EXPIRATION DATE (25-5-61, LDC) CASE MANAGER SCOTT GRANTHAM

PROJECT/EXPIRATION DATE (04/29/2016) DWG# DDZ

Planning and Development Review Department
RELEASED FOR GENERAL COMPLIANCE: ZONING 151

Rev. 1 Correction 2

Rev. 2 Correction 2

Rev. 3 Correction 3

Final plot must be recorded by the Project Expiration Date, if applicable.
Subsequent Site Plans which do not comply with the Code current at the
time of filing, and all required Building Permits and/or a notice of
construction (if a building permit is not required), must also be approved prior
to the Project Expiration Date.

2010 SOUTH LAMAR OFFICE 2010 S. LAMAR AUSTIN, TRAVIS COUNTY, TEXAS	WATERLINE PLAN AND PROFILE		512.669.5560 BIG RED DOG ENGINEERING CONSULTING 2021 E. 5TH ST. #200 (OFFICE) • 815-A BRAZZOS ST. #319 (MAIL) AUSTIN, TEXAS 78702 (OFFICE), 78701 (MAIL) WWW.BIGREDDOG.COM TEXAS REG. NO. F-11201
SHEET CU103 14 OF 41 SP-2016-0196C			

[illegible]